

Installation guide

Controller Gateway- ERC & ETC

520H10040




The Controller Gateway is meant to be used with Danfoss ETC 1H and ERC Series of controllers to interface with PC Suite (Tool4Cool and KoolProg) and perform Laboratory functions to configure, test and upload / download parameters from / in the controllers.

The Gateway and controller doesn't need to be powered separately as the Gateway takes power from the USB port of the PC/ Laptop and supplies it to controller as well.

Note: To interface ERC 21x series with PC, KoolProg is mandatory

520H10040

Mounting

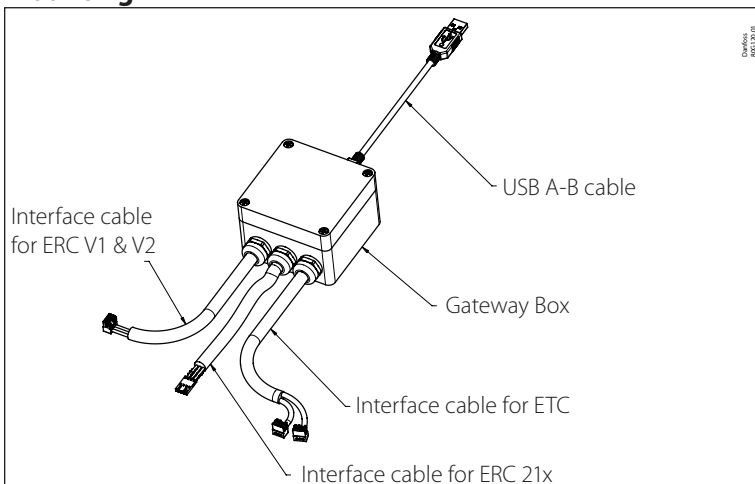

Instructions to connect and use:

1. Connect USB cable to the USB port of PC / Laptop

2. Connect the controller (ERC 11x / ERC 21x / ETC 1H) with the corresponding cable.

Caution: please see that only one controller (either ETC or ERC 11x or ERC 21x) is connected at any one point of time

Note: You do not need to power the controller

3. Run the Software PC Suite set-up and follow the instruction on the set-up wizard to install the software and drivers applicable

Contact info:
www.danfoss.com/erc